VI OF PLANE


COUNTY OF PLACER


Community Development/Resource Agency

BUILDING

SHOWER PANS

CBC 2010 § 411.0

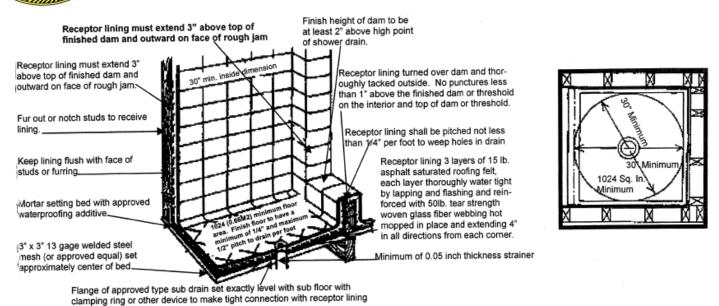

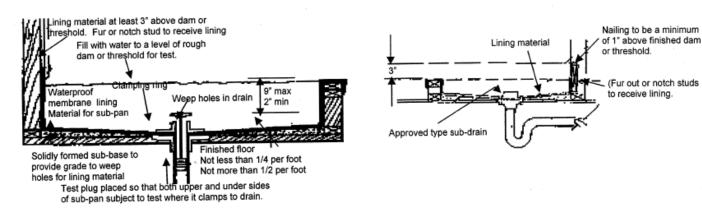

- Shower drains shall be of an approved type, suitably flanged to provide a watertight seal. The drain assembly shall be provided with weep holes to allow drainage of the pan lining. An approved strainer is to be provided. A minimum 2-inch waste pipe and trap is required.
- The dam or threshold shall be a minimum of 2-inches and a maximum of 9-inches above the top of the drain. The finished floor shall have a uniform slope of $\frac{1}{4}$ " $\frac{1}{2}$ " per foot.
- The floor area of the shower shall be 1,024 in² and allow for a 30-inch diameter circle, measured at the top of the dam or threshold. The minimum area shall be maintained to a height of 70-inches above the drain. Thresholds need to be wide enough to accommodate a 22-inch wide door.
- ➤ The pan liner shall extend up the walls a minimum of 3-inches above the top of the finished dam or threshold. The pan liner may be constructed of an approved plastic, sheet lead or copper with a 15# felt underlayment, or a 3-layer hot-mopped 15# felt built-up assembly. Refer to the CBC for specific construction requirements. The pan liner shall maintain a uniform slope of ½" ½" per foot.
- > The pan liner and drain connection is to have a standing water test filled to the top of the dam or threshold for inspection.
- Adhering tile directly to Purple or Green Board is not permitted. Purple or Green Board is allowed if floating a mortar bed with a moisture barrier.